


SYMMETRICAL ABOUT
CENTERLINE OF PAVEMENT

PROPERTY LINE OR
RIGHT-OF-WAY LINE

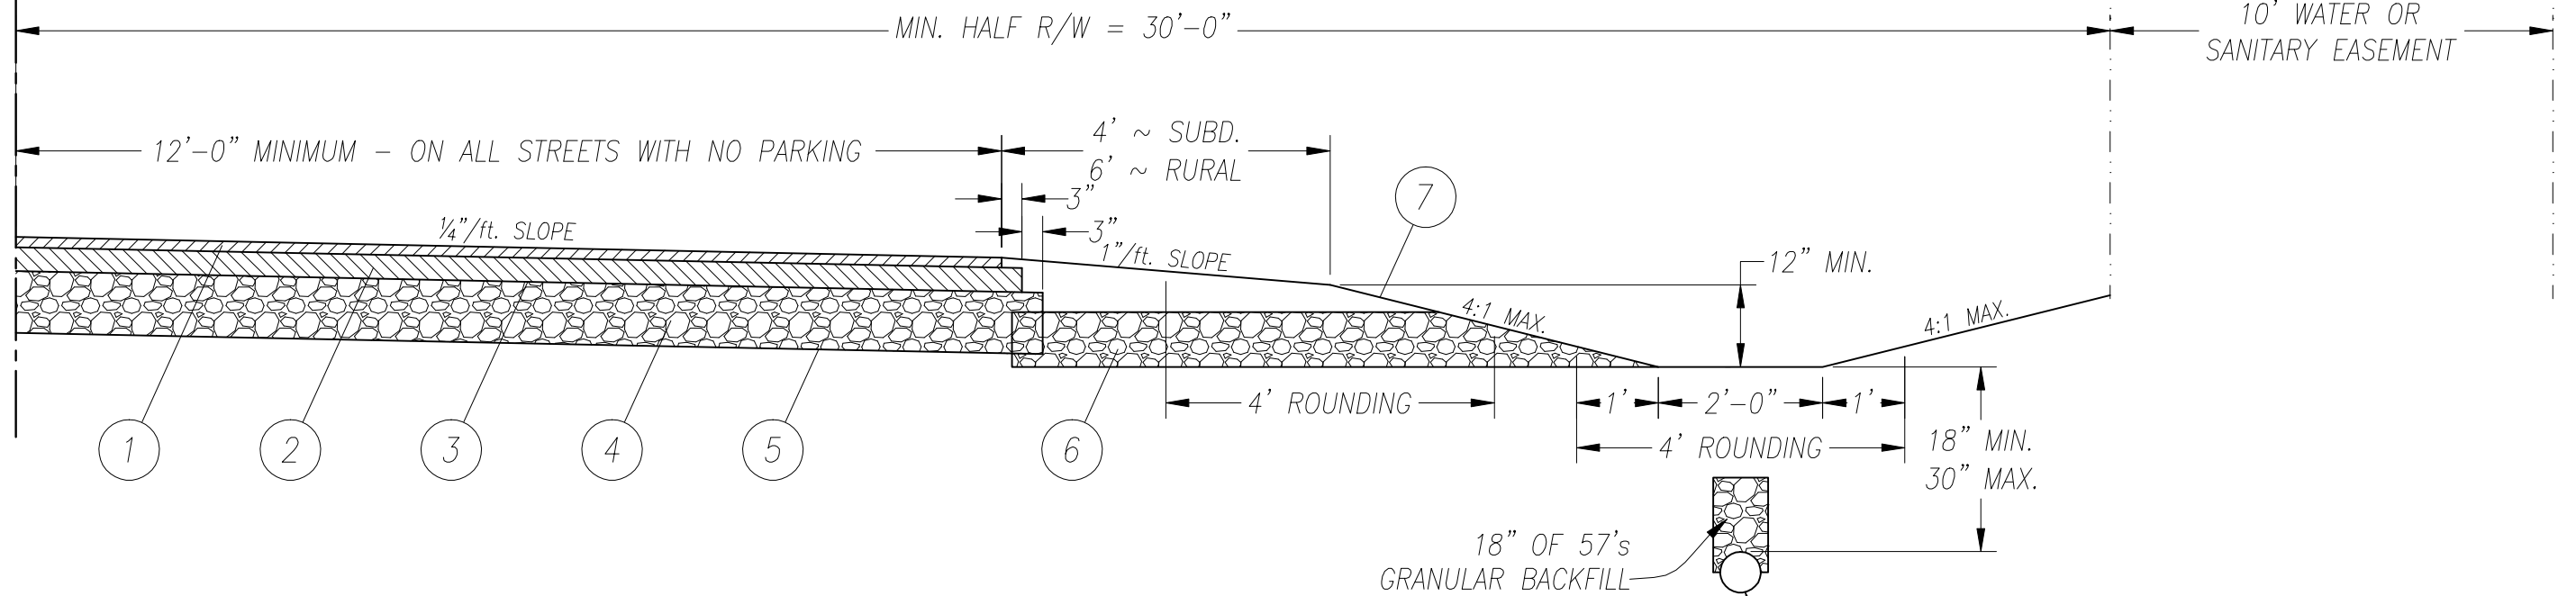

**TYPICAL HALF-SECTION
MINIMUM PAVEMENT COMPOSITION FOR FLEXIBLE PAVEMENT**

- ① ITEM 404 ~ 1 1/2" ASPHALT CONCRETE (SEE ADDITIONAL SPECIFICATIONS)
- ② ITEM 301 ~ 3 1/2" ASPHALT CONCRETE (BASE COURSE)
- ③ ITEM 408 ~ BITUMINOUS PRIME COAT, AT LEAST 0.50 GAL. PER SQ. YD.
- ④ ITEM 304 ~ 9" AGGREGATE BASE
- ⑤ ITEM 204 ~ SUBGRADE COMPACTION, ODOT ITEM 204 SPECS.
- ⑥ ITEM 605 ~ 8" AGGREGATE DRAINS (12" WIDE SPACED 50' ON A SIDE & 25' FROM THE NEAREST DRAIN ON OPPOSITE SIDE.)
- ⑦ ITEM 659 ~ SEEDING AND MULCHING, USE SEEDING MIXTURE APPROVED BY THE ALLEN COUNTY ENGINEER

18" OF 57's
GRANULAR BACKFILL

6" MIN. DIA. DRAIN TILE (BOTH SIDES OF STREET)
(706.06, 706.07, 706.08, 706.09, 707.33
(PERFORATED), 707.41 (PERFORATED)) OR AS
SPECIFIED BY THE ALLEN COUNTY ENGINEER.
ODOT CLASS C BEDDING. LOT DRAINS MAY BE
CONNECTED TO DRAIN TILE, ONLY IF TILE HAS
BEEN SIZED BY A PROFESSIONAL ENGINEER TO
HANDLE ADDITIONAL FLOW.

NOTE: 1. ROADSIDE DITCH SHALL NOT BE FILLED IN.
2. SEE ALLEN CO. STD. DRWG. DW-2 OR DW-3
FOR DRIVEWAY CONSTRUCTION.
3. STORM SEWERS SHALL BE LOCATED WITHIN
THE ROAD RIGHT-OF-WAY.

THE ITEMS LISTED ABOVE REFER TO THE MATERIAL & CONSTRUCTION SPECIFICATIONS FOUND IN THE LATEST EDITION OF
THE OHIO DEPARTMENT OF TRANSPORTATION CONSTRUCTION & MATERIAL MANUAL UNLESS NOTED OTHERWISE.

REVISIONS			ALLEN COUNTY, OHIO COUNTY ENGINEER	
NO.	DATE	BY		
1	5-30-79	TJP		
2	12-1-80	TJP		
3	9-22-92	TJP		
4	10-5-06	RJM		
			PAVEMENT - FLEXIBLE CUL-DE-SAC, LOCAL, SUBCOLLECTOR & COLLECTOR STREETS	
			STANDARD CONSTRUCTION DRAWING PF-4	
			DRAWN BY: RJM APPROVED BY: T.J. PIPER	